

Description & Connections for HLA-O



Note- Turn off the power & disconnect the power lead before opening the enclosure.
 Wires to the level float are low voltage, any other wiring should be carried out by qualified personnel.

Place link on the two bottom pins for the aux output to activate a siren when the float is activated. The output will turn off if the mute button is pressed.


Place link on the two top pins for the aux output to activate a light when the float is activated.

Float active indicator LED

Power ON Indicator LED

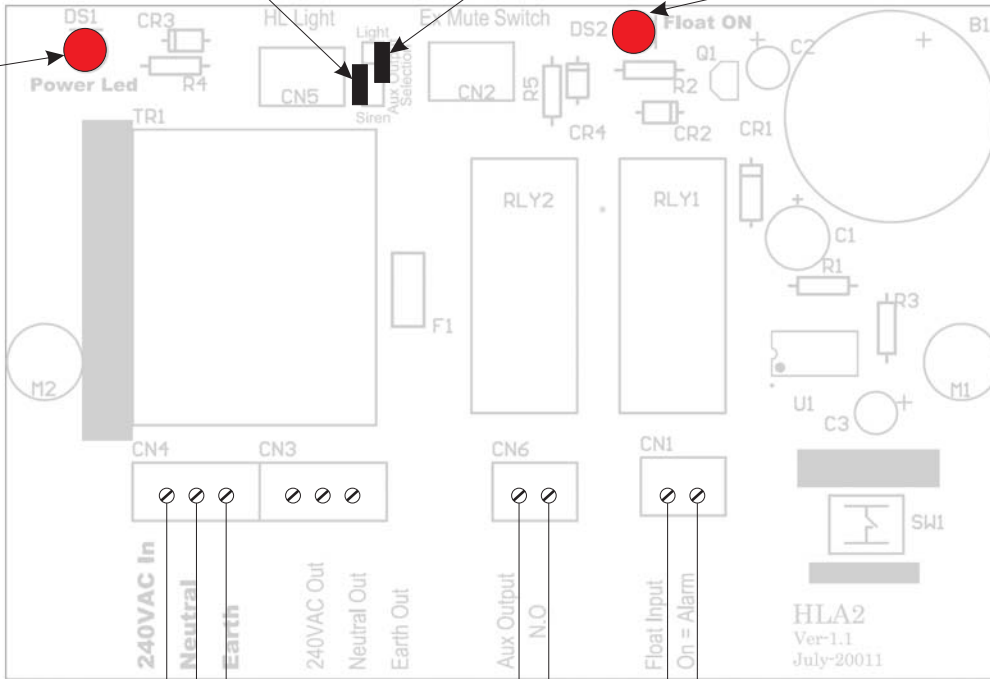

3 Pin power lead
220-240VAC

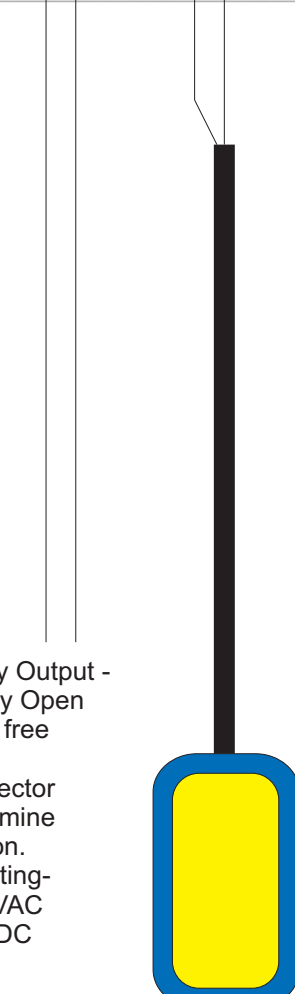

Auxiliary Output - Normally Open Voltage free contact. Use selector to determine operation. Max Rating- 5A 240VAC 5A 30VDC

Level Float
Low Voltage - 24VAC

